Estimate for the work of providing, laying of 150mm dia DI water supply at Sai lay out Lay Out near Sea college coming under Basavanapura service Station of AEE E-2-4 sub Division

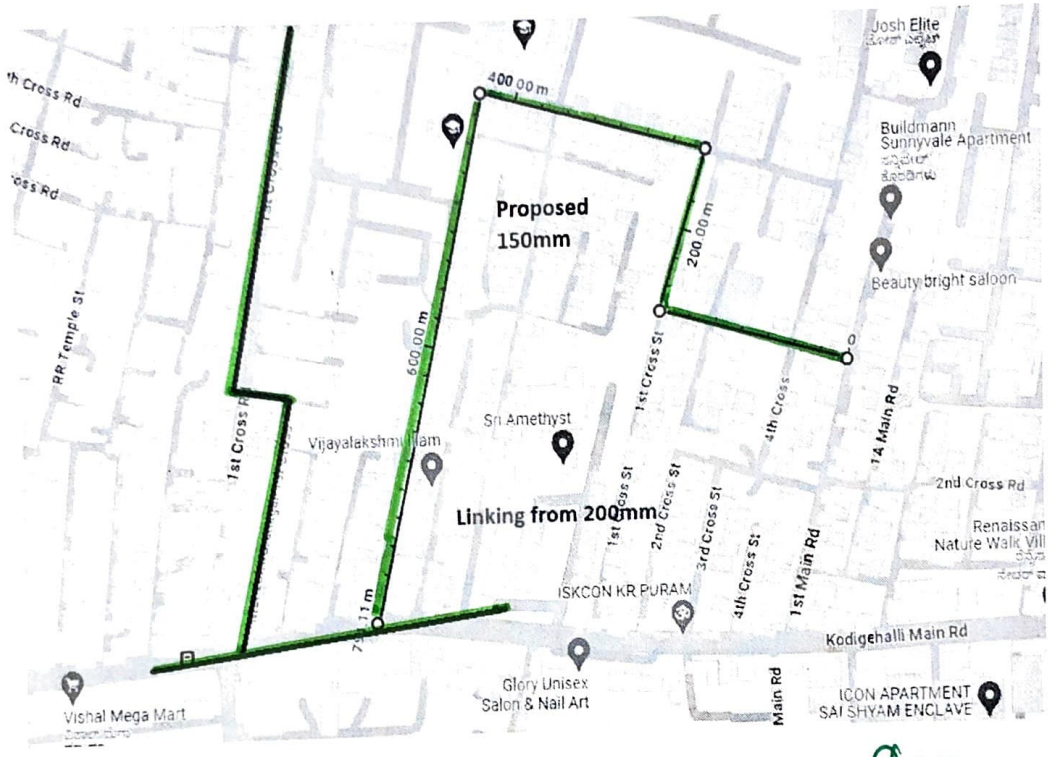

Work of providing, laying of 150mm dia DI water supply at Sal layout near sea coast under Basavangpura service station of AEE EQ-4) S/D

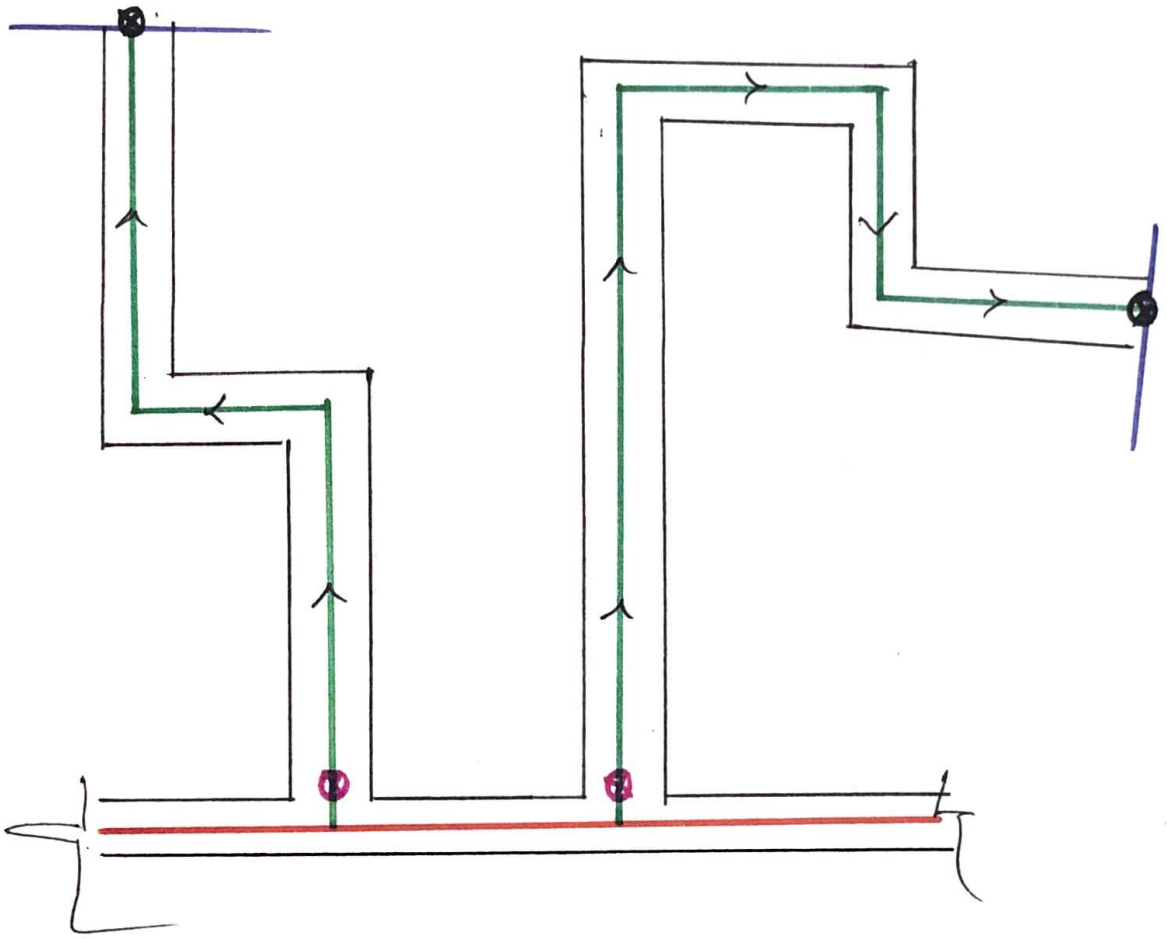

Existing 150mm ϕ WL

proposed 150mm ϕ WL

Existing 100mm ϕ WL

proposed 150mm ϕ valve

proposed 100mm ϕ valve

(AE)

~~AEE (EQ-4)~~

EE (E-2)

Sai 2/10

SDO (AE)

AEE (E2-4)

1